

# Digital 280-1 Digital Indicator



BluePort® Front interface and BlueControl Software

Maintenance manager and error list

**Large 5-digit display** 

Limit values with hysteresis, time gate and gradient

**ON/OFF** and 2-point controller

0<sub>2</sub> measurement with high-impedance input

**Function-key** 

- Customer-specific linearization for all sensors
- Galvanically isolated output
- Permanent min. and max. value storage (slave pointer)
- **†** Tare function
- Sample & hold amplifier
- Filter with suppression bandwidth (adjustable)
- Einstellbare Auflösung der Anzeige
- Settings can be blocked via password and internal switch for high security
- Extended temperature range up to 60 °C allows mounting close to the process
- Easy 2-point or offset measurement correction
- Logical combination of digital outputs, e.g. for general alarm
- RS 422/485 Modbus RTU interface
- Built-in transmitter power supply
- Splash-water proof front (IP 65)

# **APPLICATIONS**

- Furnaces and ovens
- Burners and boilers
- Weighing and batching
- Process control
- Plastics processing
- ➤ ...

#### **DESCRIPTION**

#### Front interface and Engineering Tools

Control parameter adjustment in seconds has now also been implemented in the KS 40 class of instruments. Via the BlueControl software incl. its simulation functions, and especially the convenient BluePort® front panel interface, the required set-up for a specific control task can be determined without a detailed study of the operating instructions.

Off cause almost all adjustments can be done comfortably over the instrument front. (see page 6, BlueControl)

# Limit values

The measured signal can be scaled freely and monitored for limit values and sensor break. Process status signalling is possible by two relays and six LEDs in total. Moreover, an alarm or the displayed value can be output as a 0/4...20 mA or 0/2...10 V signal via an analog output.

## Alarm hold function

Alarm statuses can be configured so that they remain unchanged until acknowledgement.

## Controller

Apart from application as an indicator, Digital 280-1 can be used as a signaller or on/off controller, as a two-point or a continuous controller.

#### Oxygen measurement:

When using a heated lambda probe, the oxygen concentration can be displayed, controlled and output directly as a standard signal.

Range with O<sub>2</sub> measurement: 0,0001% (1ppm) to 100.00% Indication of values below 1 ppm is possible via the voltage value display.

## Linearization with 15 segments

Non-linear signals, e.g. filling quantities, flows, etc. can be adapted by means of user-specific linearization.

#### Plug-in module

As a plug-in module, Digital 280-1 can be replaced very quickly without tools and without impairing the wiring.

# Password protection

If required, access to the various operating levels can be protected with a password.

#### **TECHNICAL DATA**

## **INPUTS**

## PROCESS VALUE INPUT INP1

Resolution: > 15 Bit

0 bis 4 Nachkommastellen Decimal point:

Limiting frequency: 2 Hz (analog)

Digital input filter: adjustable 0,1...100 s

Scanning cycle: 100 ms

Measured value

correction: 2-point or offset correction

# Thermocouples (Table 1)

Input impedance:  $\geq 1 M\Omega$ Effect of source resistance:  $1 \mu V/\Omega$ 

#### Cold junction compensation

Internal temperature compensation

Max. additional error  $\pm 0.5 \, K$ 

External temperature compensation

adjustable within 0 and 100 °C or 32

and 212 °F

#### Sensor break monitoring

Sensor current:  $\leq 1 \mu A$ 

#### Resistance thermometer (Table 2)

Connection: 3-wire Lead resistance: max.  $30 \Omega$ 

Input circuit monitor: Break and short circuit

# Resistance measuring range

The BlueControl software can be used to match the input to the sensor KTY 11-6 (characteristic is stored in the controller).

Physical measuring range: 0...450 Ohm

0...4500 Ohm

Linearization segments

# Current and voltage signals (Table 2)

Span start, end of span: anywhere within measuring range

Scaling: selectable

-19999...99999

15 segments, Linearization:

adaptable with

BlueControl

adjustable

Decimal point: Input circuit monitor: with 4..20mA and

2...10V 12,5% below

span start (2mA, 1V)

#### **CONTROL INPUT DI1**

Configurable as direct or invers switch or push-button!

Connection of a potential-free contact suitable for switching "dry" circuits.

Switched voltage: 2.5 V Switched current: 50 μΑ

Table 1 Thermocouple ranges

Thermoelementtyp		Meßbereich		Genauigkeit	Auflösung (∅)	
L	Fe-CuNi (DIN)	-100900°C	-1481652°F	≤ 2 K	0,05 K	
J	Fe-CuNi	-1001200°C	-1482192°F	≤ 2 K	0,05 K	
K	NiCr-Ni	-1001350°C	-1482462°F	≤ 2 K	0,1 K	
N	Nicrosil/Nisil	-1001300°C	-1482372°F	≤ 2 K	0,1 K	
S	PtRh-Pt 10%	01760°C	323200°F	≤ 2 K	0,1 K	
R	PtRh-Pt 13%	01760°C	323200°F	≤ 2 K	0,1 K	
T	Cu-CuNi	-200400°C	-328752°F	≤ 2 K	0,025 K	
С	W5%Re-W26%Re	02315°C	324199°F	≤ 2 K	0,2 K	
D	W3%Re-W25%Re	02315°C	324199°F	≤ 2 K	0,2 K	
Е	NiCr-CuNi	-1001000°C	-1481832°F	≤ 2 K	0,05 K	
B <sup>(1)</sup>	PtRh-Pt6%	0(100)1820°C	32(212)3308°F	≤ 3 K	0,15 K	
Spezial		-2575 mV		≤ 0,1 %	0,005 %	

Table 2 Resistance transducers

Type	Sensor current	Range		Accuracy	Resolution (∅)
Pt100		-200850°C	-3281562°F	≤ 1 K	0.05 1/
Pt1000		-200200°C	-328392°F	≤ 2 K	0,05 K
Spezial*		04500 <b>Ω</b> **			
Spezial	0,2 mA	0450 <b>Ω</b> **			
Poti		0160	Ω**	≤ 0,1 %	0,005 %
Poti		0450 <b>Ω</b> **			
Poti		$01600\mathbf{\Omega}^{**}$			

Characteristic KTY 11-6 (-50...150°C) is factory-set.

Table 3 Current and voltage

Range	Input resistance	Accuracy	Resolution (∅)	
020 mA	49 $\Omega$ (voltage requirement ≤ 2,5 V)	≤ 0,1 %	0,75 μΑ	
010 Volt	≈ 110 kΩ	≤ 0,1 %	0,4 mV	
-2,5115 mV*	≥1ΜΩ	≤ 0,1 %	4 μV	
-251150 mV*	≥1MΩ	≤ 0,1 %	40 μV	
-2590 mV*	≥1ΜΩ	≤ 0,1 %	4μV	
-500500 mV*	≥1MΩ	≤ 0,1 %	40 μV	
-55Volt	≈ 110 kΩ	≤ 0,1 %	0,4 mV	

<sup>\*</sup> high-impedance voltage ranges without break monitoring

approx. 5 mA

# CONTROL INPUTS DI2, DI3 (OPTION)

In common with DI1 configurable as switch or push-button!

Optocoupler input for active triggering

Nominal voltage: 24 V DC, external

Current sink (IEC 1131 Type 1) -3...5 V Logic ..0": Logic "1": 15...30 V

Current requirement:

# TRANSMITTER SUPPLY UT (OPTION)


Output: 22 mA  $/ \ge 18 \text{ V}$ 

If the universal output OUT3 is used there may be no external galvanic connection between measuring and output circuits!

### **FILTER**

A 1st order mathematic filter adjustable for time constant and bandwidth is built

#### Filterfunktion



The bandwidth is the adjustable tolerance around the process value in which the filter is active. Measured value changes exceeding the adjusted bandwidth are passed through directly.

<sup>\*\*</sup> inclusive of lead resistance

#### **OUTPUTS**

Survey of the outputs

Output	Used for:	
OUT1 (relay) OUT2 (relay) OUT3 (logic)	Limit contacts, alarms Control output	
OUT3 (continuous)	Control output, process value, set-point, control deviation, transmitter supply 13 V / 22 mA	

<sup>\*</sup> All logic signals can be OR-linked!

## **RELAY OUTPUTS OUT1, OUT2**

Contacts: 2 NO contacts with

common connection

Max. contact rating: 500 VA, 250 VAC, 2A at

48...62 Hz, resistive load

Min. contact rating: 6 V, 1 mA DC Duty cycle electric for I = 1A/2A:  $\geq$ 

800,000 / 500,000 (at  $\sim 250V /$  (resistive load))

Note:

If the relays OUT1...OUT3 operate external contactors, these must be fitted with RC snubber circuits to manufacturer specifications to prevent excessive switch-off voltage peaks.

#### **OUT3 AS UNIVERSAL OUTPUT**

Galvanically isolated from the inputs.

Freely scalable

DA-converter limiting frequency  $T_{90}$ : 50 ms

Limiting frequency of the complete continuous controller: > 2 H

Resolution: 11 bits

#### **Current output**

0/4...20 mA, configurable.

 $\begin{array}{lll} \mbox{Signal range:} & 0...\mbox{approx. } 21,5\mbox{ mA} \\ \mbox{Load:} & \leq 500\ \Omega \\ \mbox{Load effect:} & 0,02\ \%\ /\ 100\ \Omega \\ \mbox{Resolution:} & \leq 22\ \mu\mbox{A}\ (0,1\%) \\ \mbox{Error:} & \leq 40\ \mu\mbox{A}\ (0,2\%) \\ \end{array}$ 

## Voltage output

0/2...10V, configurable

 $\begin{array}{lll} \mbox{Signal range:} & 0...11 \ \mbox{V} \\ \mbox{Load:} & \geq 2 \ \mbox{k}\Omega \\ \mbox{Load effect:} & \mbox{no Effect} \\ \mbox{Resolution:} & \leq 11 \ \mbox{mV } (0,1\%) \\ \mbox{Error:} & \leq 20 \ \mbox{mV } (0,2\%) \end{array}$ 


# OUT3 used as transmitter supply

Output:  $22 \text{ mA} / \ge 13 \text{ V}$ 

#### OUT3 used as logic output

 $\begin{array}{lll} \text{Load} \leq 500 \, \Omega & \text{O/} \leq 20 \, \text{mA} \\ \text{Load} > 500 \, \Omega & \text{O/} > 13 \, \text{V} \end{array}$ 

#### Electrical connections:

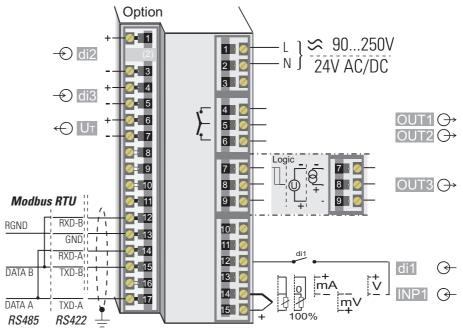

\* Pay attention to the internal switch!

#### Galvanic isolations:

- Safety isolation
- Functional isolation

Mains supply	Process value input INP1 Supplementary input INP2 Digital input di1
Relay outputs OUT1,2	RS 422/485 interface
Relay output OUT3	Digital inputs di2, 3
	Universal output OUT3
	Transmitter supply UT

#### **FUNCTIONS**

# Control behaviour

- Signaler with adjustable switching differential (ON/OFF controller)
- PID controller (2-point and continuous)

Self-tuning control parameters or adjustable manually via front keys or BlueControl software.

## Limit signalling functions

Monitoring for: exceeded max., min. or max. and min. limit value is provided.

# Signals which can be monitored:

- Input signal
- Process value
- Control deviation
- Control deviation with suppression during start-up or set-point changes

- set-point
- Output signal Y

## **Functions**

- Input signal monitoring
- Input signal monitoring with latch (reset via front key or digital input)
- Measured value change
- Measured value change and storage

Several limit signals or alarms can be OR-linked before being output. General alarms, etc.

# ALARM + MAINTENANCE MANAGER

Display of error signals, warnings, and latched limit messages in the error list. Signals are latched, and can be reset manually.

Possible signals in the error list:

- Sensor break, short circuit, reversed polarity
- Fault during self-tuning

Flashing Error LED indicates active alarm in the error list:



- latched limit messages e.g. re-calibration warning
- (If the adjusted operating hours are exceeded a message is displayed)
- e.g. maintenance interval of actuator
- (If the adjusted switching cycles are exceeded a message is displayed)
- Internal fault (RAM, EEPROM, ...)

#### **DISPLAY**

#### Display

5-digit, 19mm LED

# **POWER SUPPLY**

Depending on version:

#### AC SUPPLY

Voltage: 90...260 VAC
Frequency: 48...62 Hz
Power consumption approx. 7 VA

# UNIVERSAL SUPPLY 24 V UC

AC voltage: 20,4...26,4 VAC
Frequency: 48...62 Hz
DC voltage: 18...31 V DC
Power consumption: approx: 7 VA (W)

#### BEHAVIOUR WITH POWER FAILURE

Configuration, parameters, and adjusted set-points and the operating statuses are stored in non-volatile EEPROM.

## BluePort FRONT INTERFACE

Connection of PC via PC adapter (see "Accessories"). The BlueControl software is used to configure, set parameters, and operate the Digital 280-1.

#### **BUS INTERFACE (OPTION)**

Galvanically isolated

Physical: RS 422/485
Protocol: Modbus RTU

Transmission speed:

2400, 4800, 9600, 19.200 bits/s Address range:: 1...24

Number of controllers per bus: 32

Repeaters must be used to connect more controllers

# **ENVIRONMENTAL CONDITIONS**

#### **Protection modes**

Front panel: IP 65 Housing: IP 20 Terminals: IP 00

#### Permissible temperatures

For specified accuracy: 0...60°C

Warm-up time: <15 minutes

Temperature effect: <100ppm/K

For operation: -20...65°C

For storage: -40...70°C

#### Humidity

75% yearly average, no condensation

#### Shock and vibration

# Vibration test Fc (DIN 68-2-6)

Frequency: 10...150 Hz
Unit in operation: 1g or 0,075 mm
Unit not in operation: 2g or 0,15 mm

#### Shock test Ea (DIN IEC 68-2-27)


Shock: 15g Duration: 11ms

#### Electromagnetic compatibility

Complies with EN 61 326-1

- Complies with the immunity requirements for continuous, unattended operation
- Complies with the emmission requirements class B for rural areas Surge disturbances may increase the measurement error

Overall dimensions:

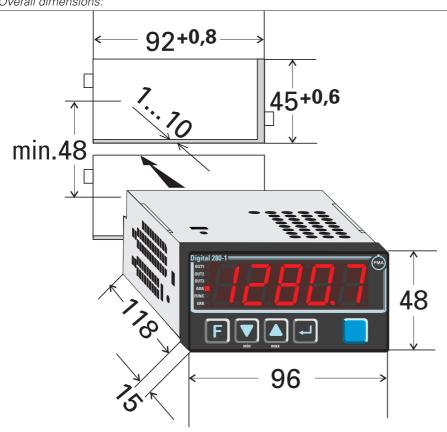

# **GENERAL**

#### Housing

Material: Makrolon 9415,

flame-retardant

Flammability class: UL 94 VO, self-extinguishing

Plug-in module, inserted from the front

#### Safety tests

Complies with EN 61010-1 (VDE 0411-1): Over voltage category II Contamination class 2 Working voltage range 300 VAC Protection class II

#### Certifications

#### CULus-certification

(Type 1, indoor use) File: E 208286

# GOST-R Certificate(on request):

For each shipment to the russian federation and GUS-states, an authenticated certificate is to be delivered with the GOST-R certificated controllers (KS4x-1, KS5x-1, KS9x-1, one certificate per shipment - 9499-047-14465).

#### Electrical connections

 Screw terminals for conductor cross-section from 0,5 to 2,5 mm<sup>2</sup>

# Mounting


Panel mounting with two fixing clamps at top/bottom or left/right Close mounting possible

Mounting position: not critical Weight: 0,27 kg (9.52 oz)

## Accessories supplied with unit

Operating instructions 2 fixing clamps

# **ORDERING INFORMATION**

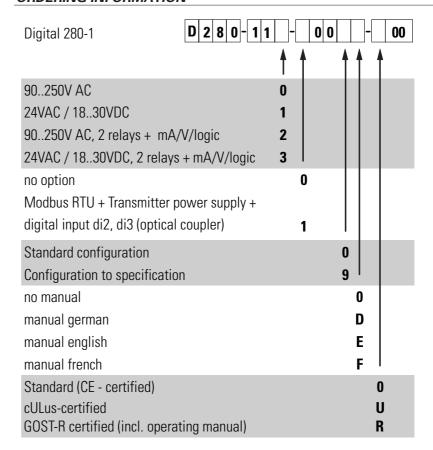

## **ACCESSORIES**

Description	Order no.	
PC adapter, for connecting Blue	9407-998-00001	
Standard rail adapter		9407-998-00061
Operating manual	German	9499-040-67318
Operating manual	English	9499-040-67311
Operating manual	French	9499-040-67332
BlueControl Mini	German/English/French	www.pma-online.de
BlueControl Basic	German/English/French	9407-999-11001
BlueControl Expert	German/English/French	9407-999-11011
Operating manual Operating manual Operating manual BlueControl Mini BlueControl Basic	English French German/English/French German/English/French	9499-040-67318 9499-040-67311 9499-040-67332 www.pma-online.d 9407-999-11001

5

#### **ACCESSORY EQUIPMENT**

## **BlueControl (Engineering Tool)**

PC-based program for configuring, setting parameters, and operating (commissioning) Digital indicator, controller and temperature limiter of the BluePort® series.

Software requirements: Windows 95/98/NT/2000.

The built-in simulation serves to test the controller settings, but can also be used for general training and observing the interaction between controller and control loop.

#### Simulation

Display of two parameters was suppressed:

Name	Description	Visible
Lim	Limit	✓
L.1	lower limit 1	
H.1	upper limit 1	
HYS.1	hysteresis I	✓
dEL.1	limit 1 delay	✓
L.2	lower limit 2	✓

Configurations that can only be implemented via the BlueControl software (not via the front-panel keys):

- Customer-specific linearizations
- Enable "forcing" for inputs/outputs.
   Forcing allows to write the analog and digital inputs and outputs via Modbus interface.
- Adjustment of limits for operating hours and switching cycles
- Switch-over to 60 Hz mains frequency
- Disable operator actions and operating levels, plus password definition
- Prevent automatic optimization of cycle times T1, T2

#### Hardware requirements:

A PC adapter (see "Accessories") is required for connecting the controller.

Updates and demo software can be downloaded from: www.pma-online.de

## BlueControl, versions and functions:

	FUNCTIONALITY	MINI	BASIC	EXPERT
	parameter and configuration setting	yes	yes	yes
	controller and loop simulation	yes	yes	yes
	download: trnsfer of an engineering to the controller	yes	yes	yes
	online mode/ visualization	SIM only	yes	yes
	defining an application specific linearization	yes	yes	yes
	configuration in the extended operating level	yes	yes	yes
	upload: reading an engineering from the controller	SIM only	yes	yes
	basic diagnostic functions	no	no	yes
	saving data file and engineering	no	yes	yes
	printer function	no	yes	yes
	online documentation, help	yes	yes	yes
	implementation of measurement value correction	yes	yes	yes
	data acquisition and trend display	SIM only	yes	yes
	wizard function	yes	yes	yes
	extended simulation	no	no	yes
	programmeditor (KS 90-1prog only)	no	no	yes



#### **PMA**

Prozeß- und Maschinen- Automation GmbH P.O. Box 31 02 29 D-34058 Kassel

Tel.: +49 - 561- 505 1307 Fax: +49 - 561- 505 1710 E-mail: mailbox@pma-online.de Internet: www.pma-online.de

# Your local representative: